

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001.

No. F6/MS/DPS/2005/1439

Dated: 7.7.2005

To,

The Principal,
Shaheen Public School,
F-129, Abul Fazal Enclave-II,
Shaheen Bagh, New Delhi,

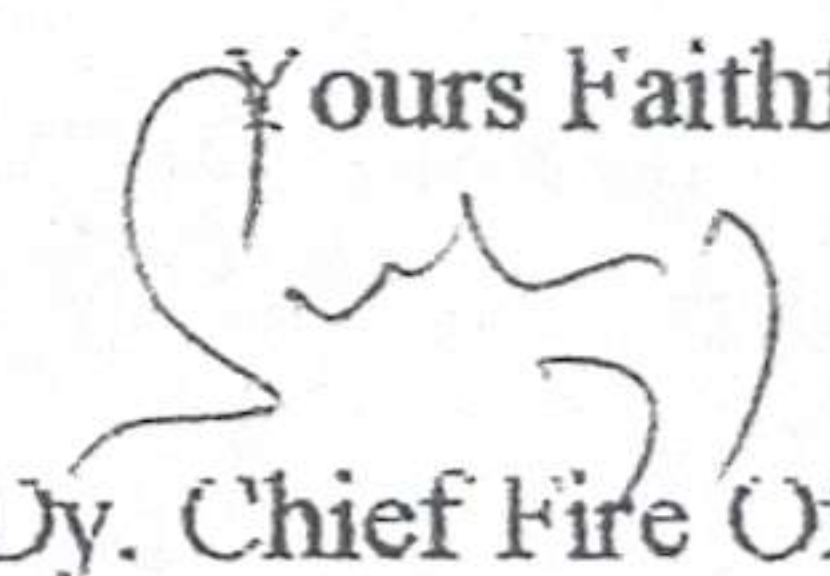
Sub: - No objection certificate in respect of Shaheen Public School, F-129 Abul Fazal Enclave -II, Shaheen Bagh, New Delhi.

Sir,

Please refer to your letter No Nil dated 18-03-2005 on subject cited above. In this connection it is to inform you that the aforesaid premises was inspected by officers of this department on dated 01-06-2005 to verify the fire safety arrangement provided there in Shri Sharik was present at the time of inspection.

During the course of inspection it was observed that the School building is comprised of ground floor and first floor the building is approachable to the fire engine the fire safety arrangement provided such as one water Co2 type fire extinguisher 9 Ltrs. capacity and one Co2 type 4.5 Kg. capacity at each floor, one hose reel connected with overhead tank of 2500 ltrs. capacity with proper boosting arrangement etc. were checked/tested and found in satisfactory working condition.

In view of the above satisfactory fire safety arrangement provided by the management this department has no objection for the grant of license from fire safety point of view. The management is advised to maintain the fire safety arrangement in good working condition as seen during the inspection.

Yours Faithfully

Dy. Chief Fire Officer
Delhi Fire Service

Copy to: -

Zonal Commissioner,
M.C.D. Lajpat Nagar,
Delhi.